Embedded PC Based Controller for use in VME Bus Based Data Acquisition System

Gaurav, Mohit Kalra, S. K. Jain, D. A. Roy, B. B. Biswas

REACTOR CONTROL DIVISION, BHABHA ATOMIC RESEARCH CENTRE, MUMBAI.

ABSTRACT

An embedded PC based Controller module, named System Controller Module (SCM), has been developed at Reactor Control Division (RCnD), BARC. This module uses standard PC-104 bus based CPU module integrated with a protocol translator card to provide an interface between the CPU module and VME bus. The signal interface between PC-104 bus of CPU module and translator card is achieved through stackable connectors. SCM can be interfaced with 16bit slave I/O modules on VME bus for Data Acquisition and Control. This development provides low cost PC based platform for developing I/O intensive embedded system requiring high processing power. SCM module is fully compatible with PC architecture and is available in Double Euro modular form factor. Module has self diagnostics features to test software integrity using onboard watchdog timer. The module provides dual Ethernet link for SCM communication. The has been successfully assembled, integrated and tested along with VME based high speed acquisition (Machinery data system Protection System), which has been developed in RCnD for condition monitoring of rotating machines. SCM acts as a configuration controller and data manager for this system.

DESIGN OF INTERFACE

The PC-104 bus based CPU module along with the Protocol Interface Card forms the System Controller Module (SCM) as shown in figure-2 The Protocol Interface card provides interfacing between PC-104 bus and VME bus. The interconnection between the CPU module and Protocol Interface Card is through stackable connector. The Protocol Interface Card has Eurocard formfacor. Figure-1 shows the block diagram of the SCM. SCM acts as a master module and can control slave I/O modules on the VME bus. The Protocol Interface card utilizes a CPLD which translates signals from one bus type to the other. VHDL language is used for the implementation of CPLD logic. The Algorithm implemented in CPLD for data transfer between the PC-104 card and VME slave module is as follows:. -Assert address strobe on VME bus on valid address of PC-104 bus. -Wait for *write signal* from the PC-104 and assert data strobes and write signal on VME bus and de-assert ready signal on PC-104 bus on reception of write *signal* on PC-104 bus. -Wait for *acknowledgement* on VME bus from I/O slave and assert *ready signal* on PC-104 bus after reception of *acknowledgement*. -Wait for write signal to de-assert on PC-104 bus and then de-assert data strobes, write signal on VME bus. -De-assert address strobe on VME bus after de-assertion of *acknowledgement*.

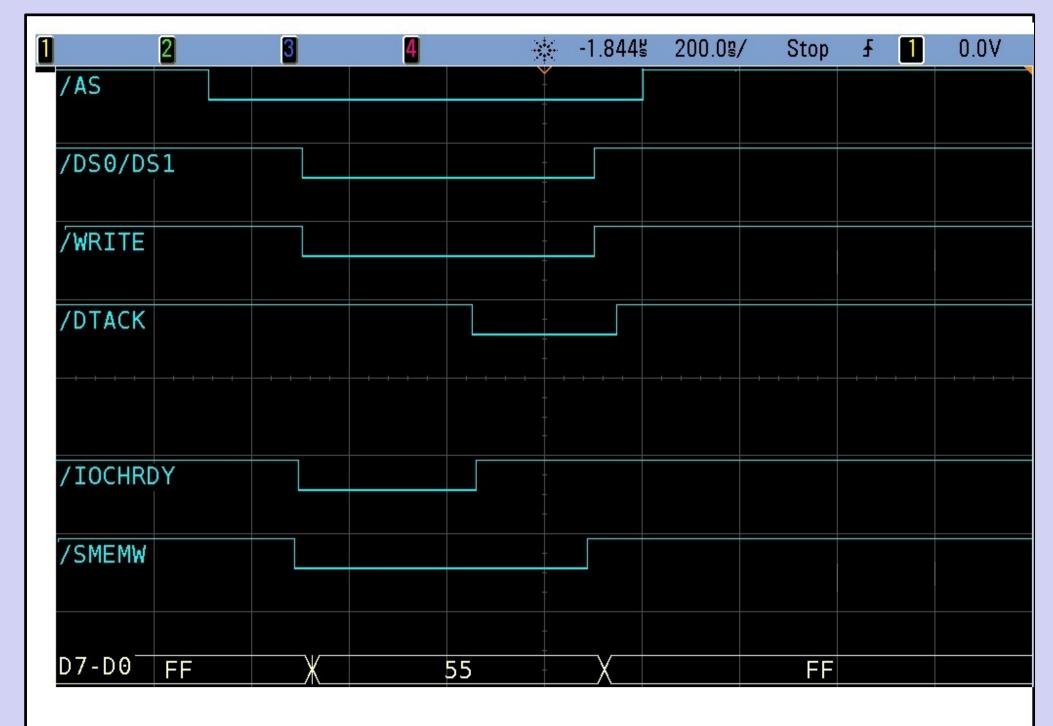


Figure 3: Timing diagram of VME and PC-104 Signals

INTRODUCTION

In the second setup the SCM has been assembled, integrated and successfully tested along with VME based high speed data acquisition system known as Machinery Protection System (MPS)[4]. This system has been developed in RCnD for condition monitoring of rotating machines. SCM acts as a configuration controller and data manager for this system. In this setup, processing module of MPS known as Machinery Protection Module (MPM), having VME interface, is mounted on the VME back plane along with SCM. MPM acts on the configuration data received from the user through Engineering Console. In this setup SCM provides configuration data to the MPM through VME interface. SCM receives configuration from parameters the Console through Engineering Ethernet communication. Reliable Ethernet communication between SCM and Engineering Console is achieved via TCP/IP over Ethernet. Open source TCP/IP stack is used to facilitate TCP/IP communication. In this experiment SCM is able to configure the system and the required data transfer rate of 2Mbytes/second is achieved.

There are many different industrial buses and technologies used for different applications. VME is one of the popular 16/32/64 bit backplane bus [1] which has been used in many applications like control, aerospace, military etc. Embedded systems utilizing PC-104 bus based modules are also widely used in many data acquisition applications because of its features like small structure size, self-stacking, PC platform, high quality and low cost. Using these two widely used technologies, System Controller Module has been developed, which uses PC-104 bus based CPU module along with VME interface with standard VME based I/O modules for data acquisition and control. The VME interface is achieved by using a Protocol Interface Card which provides protocol interconnection between PC-104 bus signals and VME bus signals. The SCM has been designed, assembled, and successfully tested along with a VME based acquisition system (Machinery data

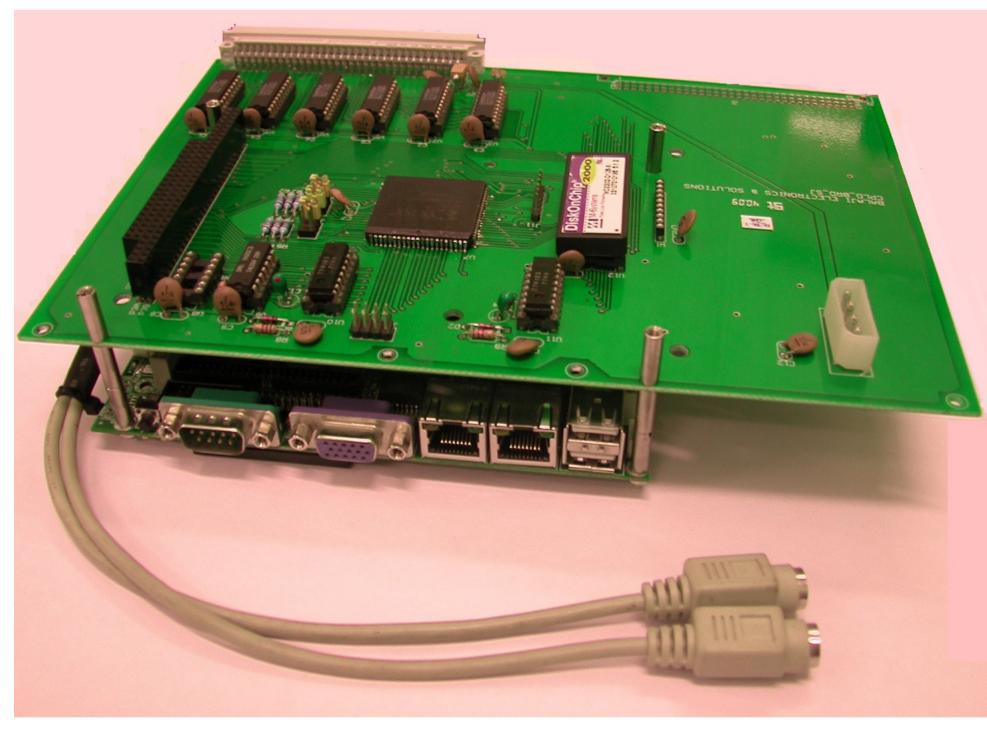


Figure 2: System Controller Module.

EXPERIMENTS AND RESULTS:

SCM has been tested and validated on two experimental setups. In the first experimental setup, the SCM is validated by integrating and testing it with standard VME bus based Analog Input Board (AIB). VME based AIB is a high performance analog I/O board designed for safety applications. Application software for SCM has been developed on Borland C. In this setup, one AI board and SCM sit on the VME back plane. A reference analog input is connected to the AI board. The SCM configures the AI board and periodically reads the analog input data. Reception of correct data validates the VME interface of the SCM. Figure -3 shows the timing diagram of the VME and PC-104 signals taken through oscilloscope for one cycle of data transfer. Diagram shows valid signal generation on the VME and PC-104 bus.

CONCLUSION

This paper has presented an embedded PC based Controller module which provides interface between the CPU module and VME bus. The design provides a low cost PC based processing platform for VME bus based I/O boards.

REFERENCES

[1] American National Standards Institute, IEEE standard for a versatile backplane bus: VMEbus, ANSI/IEEE Standard 1014-1987.

[2] PC/104 Specification, Version 2.3, June 1996.
[3] M. Kalra, D. A. Roy, C. K. Pithwa, "Interface Board for Interfacing PC-104 Bus Based SBC Module With Euro Bus Based Boards", BARC Newsletter, December 2004.
[4] D. A. Roy, P. K. Kavalan, Sanjay Jain, Mohit Kalra, B. Kannaiah, C. K. Pithawa, B. B. Biswas, "Development of Machinery Protection System," ICOVP'07, BESU, Shibpur, Jan-Feb 2007.

Protection System).

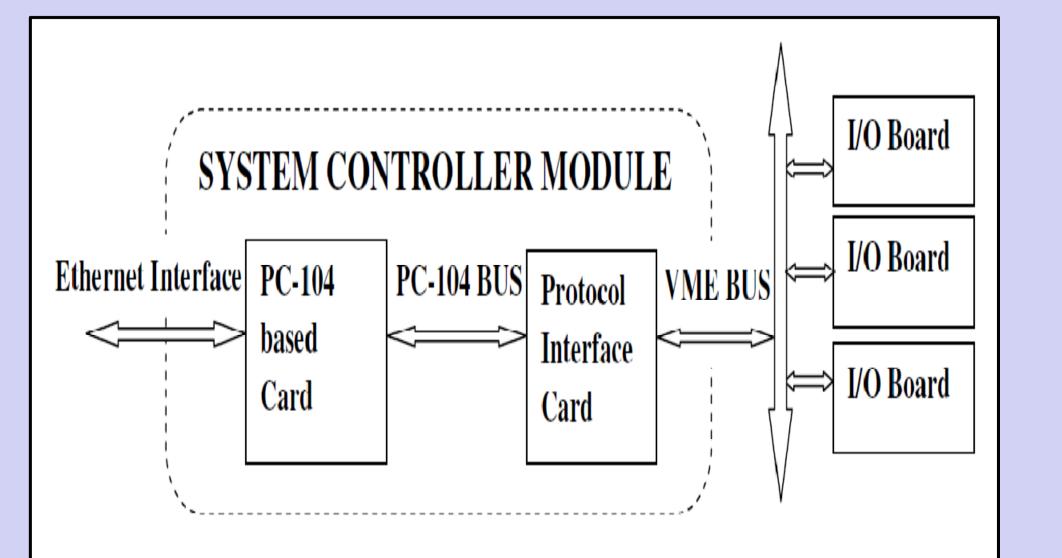


Figure 1: System Controller Module Block Diagram.

Presented by: GAURAV, REACTOR CONTROL DIVISION, BARC.